



012

BMTRADA

CERTIFICATE OF REGISTRATION

This is to certify that

Universal Tube & Plastic Ind Ltd
P.O. Box 16879
Jebel Ali
Dubai
United Arab Emirates

has been audited and found to meet the requirements of standard
ISO 9001:2008 Quality Management System

Scope of certification

Manufacture of Galvanized and Black Steel Tubes

Certificate number: 977

Issue number: 2015-01

Certificate start date: 18 December 2015

Certificate expiry date: 22 September 2018

Date of initial certification: 12 January 2000

Signed on behalf of Tom Johnston
General Manager
Central Certification Services

BM TRADA Certification Ltd, Chiltern House, Stocking Lane, High Wycombe, Buckinghamshire, HP14 4ND, UK is part of the Exova Group, registered address: 6 Coronet Way, Centenary Park, Eccles, M50 1RE

This certificate remains the property of BM TRADA Certification Ltd. This certificate and all copies or reproductions of the certificate shall be returned to BM TRADA Certification Ltd or destroyed if requested. Further clarification regarding the scope of this certificate and verification of the certificate is available through BM TRADA at the above address or at www.bmtrada.com

The use of the UKAS accreditation mark indicates accreditation in respect of those activities covered by the accreditation certification 012

Multisite clients - The scope of certification shown above includes the participating sites shown in appendix A

Certificate of Conformity
with requirements acc. to DIN EN 10255:2004+A1:2007

Inspection Report for TÜV-file : 1326WL53612/2

Based on the carried out from 12th until 13th of April 2011 testing of specimen from following structural products:

**Welded tubes of series H and M as well as of type L1 and L2,
OD 13,5 mm up to 165,1 mm, from non-alloy steel suitable for welding and threading
according to DIN EN 10255:2004+A1:2007**

produced by the company

**Universal Tube & Plastic Industries LTD.
P.O. Box 16879, Jebel Ali Free Zone,
Dubai, United Arab Emirates**

hereby in accordance with Table ZA.2.2 of DIN EN 10255:2004+A1:2007 for the dimensional limits, the yield point and the leak-tightness in conformity system 3 are communicated the listed in the enclosures test results.

Because for the tested product are in sufficient quantity available test results from previous periods are performed the tests in accordance with clause 12.2.1 and 12.2.4 in reduced amount and by application of document NB-CPD/AG/03/005r2 in the test laboratory of manufacturer witnessed by expert of notified test body.

The approved construction products are confirm with the published for the conformity system 3 regulations in annex ZA of the DIN EN 10255:2004+A1:2007.


The manufacturer is authorized to mark the construction products with the sign of conformance proof "CE" according annex ZA.3 as long as endure the technical and organisation production conditions came across during this approval.

Hamburg, 2011-05-18

Test body
Construction products for metal structure
Head of the notified body



D. Hesse, Dipl.-Ing.



Enclosure: - Report no. 1326WL53612/2 from 2011-05-16 with enclosures

bsi.



By Royal Charter

Certificate

This is to certify that:

Universal Tube & Plastic Ind. Ltd.
PO Box 16879
Jebel Ali Free Zone
Dubai
United Arab Emirates

Holds Certificate Number:

SMA 506244

In respect of:

**Manufacture of non alloyed Steel High Frequency Induction Welded Tubes of DN 15mm - 150mm
Black / Galvanised in Plain / Threaded Ends**

This is to declare that BSI has performed a specific materials assessment in connection with the quality management system of the above named company and has established that the requirements of Annex I, section 3.1 and 4.3 of the Pressure Equipment Directive 97/23/EC are met for the above activities (see page 2).

For and on behalf of BSI:

Gary Fenton, Global Product Certification Director

First Issued: 11/04/2006

Latest Issue: 12/08/2015

Expiry Date: 10/04/2018

Page: 1 of 2

...making excellence a habit.™

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.
A member of BSI Group of Companies.

Certificate

No. SMA 506244

Additional Information

Scope of Certificate Validity

Product	Material	Dimensions	Base Material
Welded Tubes	Non alloyed Steel	DN 15mm – 150mm	Coiled Plate

Note: This certificate is only valid if a current ISO 9001 certificate is in force whose scope covers the manufacture of materials.

First Issued: 11/04/2006


Latest Issue: 12/08/2015

Expiry Date: 10/04/2018

Page: 2 of 2

This certificate has been issued by and remains the property of BSI Assurance UK Ltd, Kitemark Court, Davy Avenue, Knowlhill, Milton Keynes MK5 8PP, United Kingdom and should be returned immediately upon request.
To check its validity telephone +44 (0) 845 080 9000. An electronic certificate can be authenticated [online](#).

BSI Assurance UK Limited, registered in England under number 7805321 at 389 Chiswick High Road, London W4 4AL, UK.
A member of BSI Group of Companies.

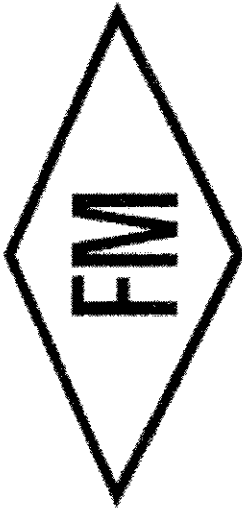

APPROVED

Certificate of Compliance

This certificate is issued for the following:

Schedule 40 Steel Sprinkler Pipe
Sizes: ¾ through 6 inch NPS
(as shown in Table below)

Prepared for:

Universal Tube and Plastic Industries Ltd
Jebel Ali Free Zone
PO Box 16879
Dubai,
United Arab Emirates

Manufactured at:

Universal Tube and Plastic Industries Ltd
Jebel Ali Free Zone
PO Box 16879
Dubai,
United Arab Emirates


FM Approvals Class: 1630 - Steel Pipe for Automatic Fire Sprinkler Systems

Approval Identification: 0003043545 Approval Granted: June 29, 2012


Said Approval is subject to satisfactory field performance, continuing Surveillance Audits, and strict conformity to the constructions as shown in the Approval Guide, an online resource of FM Approvals.

For more than 160 years FM Approvals has partnered with business and industry to reduce property losses.

Richard B. Dunne
Group Manager -Hydraulics
FM Approvals
1151 Boston-Providence Turnpike
Norwood, MA 02062

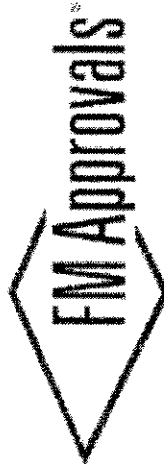

Member of the FM Global Group

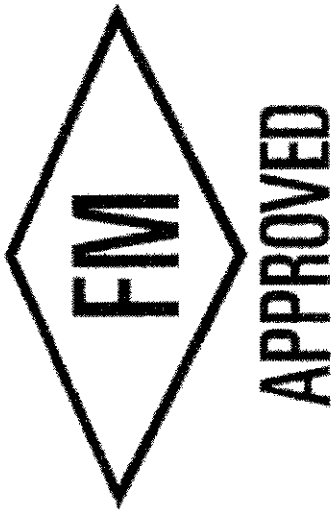

Certificate of Compliance


Product	Listing Country	Nominal Pipe Size, in	Rated Working Pressure, psi	Rated Working Pressure, kPa	Certification Type
Schedule 40 a, b, c, d, l, p	UAE	3/4, 1, 1-1/4, 1-1/2, 2, 2-1/2, 3, 3-1/2, 4, 5 and 6	300	2070	FM Approved

Remarks

a.	FM Approved for use with FM Approved pipe couplings on rolled or cut grooves.
b.	FM Approved for use with FM Approved pipe fittings when threaded.
c.	FM Approved for use in welded systems when supplied with standard bevel on ends.
d.	When hot dip galvanized by factory, the sprinkler pipe is FM Approved for dry pipe systems.
j.	3/4 in (20 mm) nominal size limited to use as valve trim or other periphery service.
p.	Manufactured out of ASTM A53 Grade B steel as alternate material.



Member of the FM Global Group

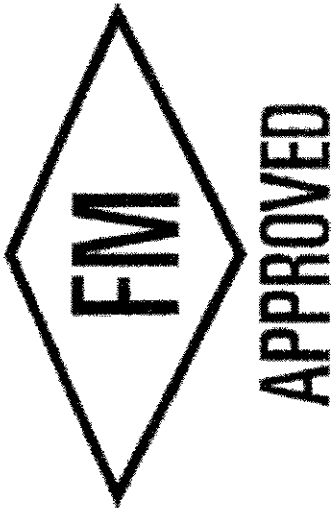

Certificate of Compliance

This certificate is issued for the following:

Schedule 10 Steel Sprinkler Pipe
Sizes: ¾ through 6 inch NPS
(as shown in Table below)

Prepared for:

Universal Tube and Plastic Industries Ltd
Jebel Ali Free Zone
PO Box 16879
Dubai,
United Arab Emirates

Manufactured at:

Universal Tube and Plastic Industries Ltd
Jebel Ali Free Zone
PO Box 16879
Dubai,
United Arab Emirates


FM Approvals Class: 1630 – Steel Pipe for Automatic Fire Sprinkler Systems

Approval Identification: 0003043545 Approval Granted: June 29, 2012

Said Approval is subject to satisfactory field performance, continuing Surveillance Audits, and strict conformity to the constructions as shown in the Approval Guide, an online resource of FM Approvals.

For more than 160 years FM Approvals has partnered with business and industry to reduce property losses.

Richard B. Dunne
Group Manager - Hydraulics
FM Approvals
1151 Boston-Providence Turnpike
Norwood, MA 02062

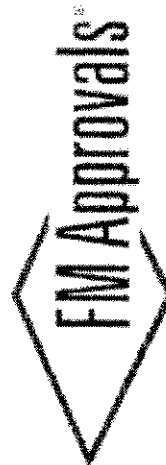

Member of the FM Global Group




APPROVED

Certificate of Compliance

Product	Listing Country	Nominal Pipe Size, in	Rated Working Pressure, psi	Rated Working Pressure, kPa	Certification Type
Schedule 10 ^{a, c, d, g, j, q}	UAE	3/4, 1, 1-1/4, 1-1/2, 2, 2-1/2, 3, 3-1/2, 4, 5 and 6	300	2070	FM Approved ^d

Remarks

a.	FM Approved for use with FM Approved pipe couplings on rolled grooves.
c.	FM Approved for use in welded systems when supplied with standard bevel on ends.
d.	When hot dip galvanized by factory, the sprinkler pipe is FM Approved for dry pipe systems.
g.	FM Approved for use with plain end fittings.
j.	3/4 in (20 mm) nominal size limited for use in valve trim and other periphery service.
q.	Manufactured out of ASTM A135 Grade B steel as an alternate material.

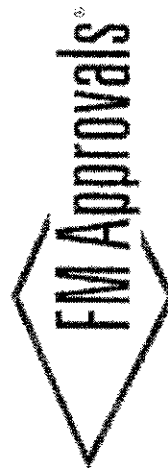

Member of the FM Global Group

CERTIFICATE OF COMPLIANCE

Certificate Number 20120618-EX15034
Report Reference EX15034-2006-04-14
Issue Date 2012-June-18

Issued to: UNIVERSAL TUBE & PLASTIC INDUSTRIES LTD
JEBEL ALI FREE ZONE
PO BOX 16879
DUBAI, UNITED ARAB EMIRATES

**This is to certify that
representative samples of**

Metallic Sprinkler Pipe


Schedule 40 (black or galvanized), Grade A, steel pipe in the 1/2, 3/4, 1, 1-1/4, 1-1/2, 2, 2-1/2, 3, 3-1/2, 4, 5, 6 and 8 in. sizes and Grade B, steel pipe in the 1, 1-1/4, 1-1/2, 2, 2-1/2, 3, 3-1/2, 4, 5, 6 and 8 in. sizes.

Schedule 10 (black or galvanized), Grade A, steel pipe in the 3/4, 1, 1-1/4, 1-1/2, 2, 2-1/2, 3, 3-1/2, 4, 5, 6 and 8 in. sizes. And Grade B, steel pipe in the 1, 1-1/4, 1-1/2, 2, 2-1/2, 3, 3-1/2, 4, 5, 6 and 8 in. sizes

Have been investigated by UL in accordance with the Standard(s) indicated on this Certificate.

Standard(s) for Safety: UL 852 – Standard for Metallic Sprinkler Pipe for Fire Protection Service
Additional Information: See the UL Online Certifications Directory at www.ul.com/database for additional information

Only those products bearing the UL Listing Mark should be considered as being covered by UL's Listing and Follow-Up Service.

The UL Listing Mark generally includes the following elements: the symbol UL in a circle:  with the word "LISTED"; a control number (may be alphanumeric) assigned by UL; and the product category name (product identifier) as indicated in the appropriate UL Directory.

Look for the UL Listing Mark on the product.

William R. Carney, Director, North American Certification Programs

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at www.ul.com/contactus





UNIVERSAL TUBE AND PLASTIC INDUSTRIES LIMITED
 P. O. BOX: 16879, JEBEL ALI FREE ZONE, DUBAI-UNITED ARAB EMIRATES,
 TEL.: 00971 4 8835966, FAX.: 00971 4 8835675,
 E-mail: utpinfo@universaltubes.com
 Website: www.universaltubes.com

DECLARATION OF PERFORMANCE

(According to Regulation EU No 305/2011)

No: UTP/DOP/2013/003

1)	Unique identification code of the product type	Non-Alloy steel tubes suitable for welding and threading OD 13.5 MM to 165.1 MM for M & H Series and of type L1 & L2, Grade S 195 T, Steel No 1.0026
2)	Type, batch or serial number or any other element allowing identification of the construction product	In accordance to the certificate that is supplied with the appropriate material (Ref. to Mill Test Certificate)
3)	Intended use or uses of the construction product, in accordance with the applicable harmonised technical specification, as foreseen by the Manufacturer	Distribution of aqueous liquids, gas and fuel
4)	Name, registered trade name or registered trade mark and contact address of the Manufacturer	UNIVERSAL TUBE AND PLASTIC INDUSTRIES LIMITED, P. O. Box: 16879, Jebel Ali Free Zone, Dubai-United Arab Emirates.
5)	System or systems of assessment and verification of constancy of performance of the construction product	System 3
6)	Harmonized Standard	EN 10255:2004+A1:2007

Notified certification body TUV Nord 0045 oversaw the initial type testing of the product by an approved laboratory and issued the ITT report. (Inspection report for TUV file: .1326WL53612/2.)


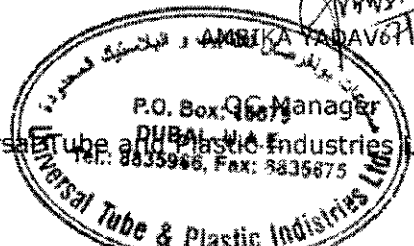
7)	Declared Performance	
----	----------------------	--

Essential characteristics	Performance	Harmonised Technical Specification
Reaction to fire	Euroclass A1	EN 10255:2004+A1:2007
Yield Strength	195 MPa min	
Dimensional tolerances	EN 10255:2004+A1:2007	
Durability	Coated (GI) with 55µm min	
Leak tightness	50 bar min for at least 5 second	
Dangerous substances	NPD	

8)	The performance of the product identified in points 1 & 2 is in conformity with declared performance in point 7
----	---

This declaration of performance is issued under the sole responsibility of the manufacturer identified in point 4.

Signed for and on behalf of the manufacturer by:
 (Date: 07.02.2016)



 P.O. Box: 16879, Jebel Ali Free Zone, Dubai-United Arab Emirates.
 Universal Tube and Plastic Industries Ltd. Dubai, UAE.
 Tel.: 8835966, Fax: 8835675